


# Cal OSHA 3205 and AB 685

## Notices and Actions for COVID-19 Positive Result


### COVID-19 POSITIVE EMPLOYEE<sup>1</sup>

<sup>1</sup>Tests positive with virus detecting test (not anti-body)

#### Emergency COVID Standard 3205 Regs

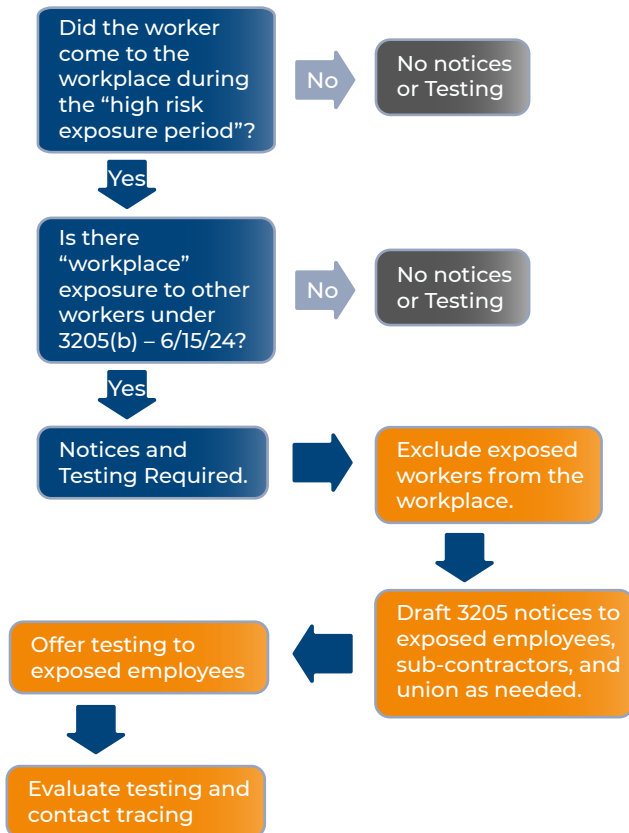

#### AB 685 Labor Code 6409.6 et seq

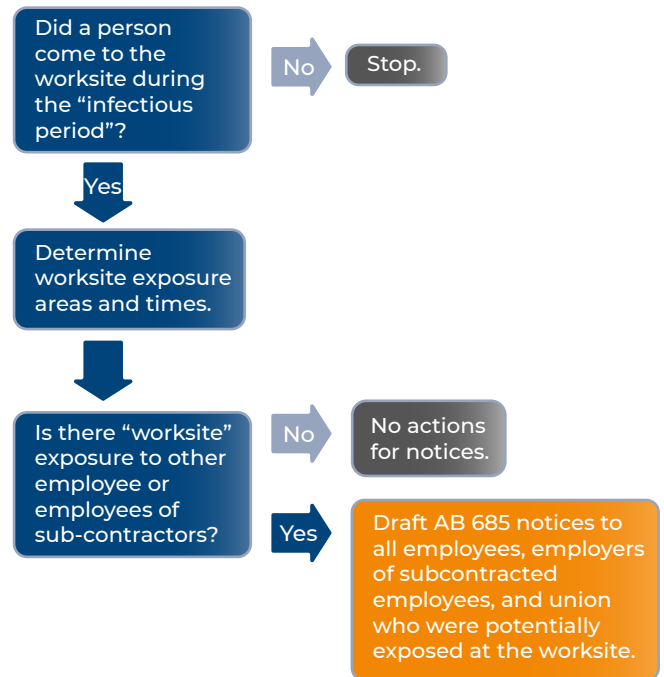

### COVID-19 EXPOSED EMPLOYEE<sup>2</sup>

<sup>2</sup>Defined in 3205(b) as being within six feet for a cumulative total of 15 minutes or great in any 24-hour period during the "high risk exposure period."

